


MBA MOTOR DRIVEN FIRE ALARM BELL

24VDC
INDOOR / OUTDOOR
WALL MOUNT ONLY

MBA6_040521_Henry_a

MBA-6-24
MBA-8-24
MBA-10-24

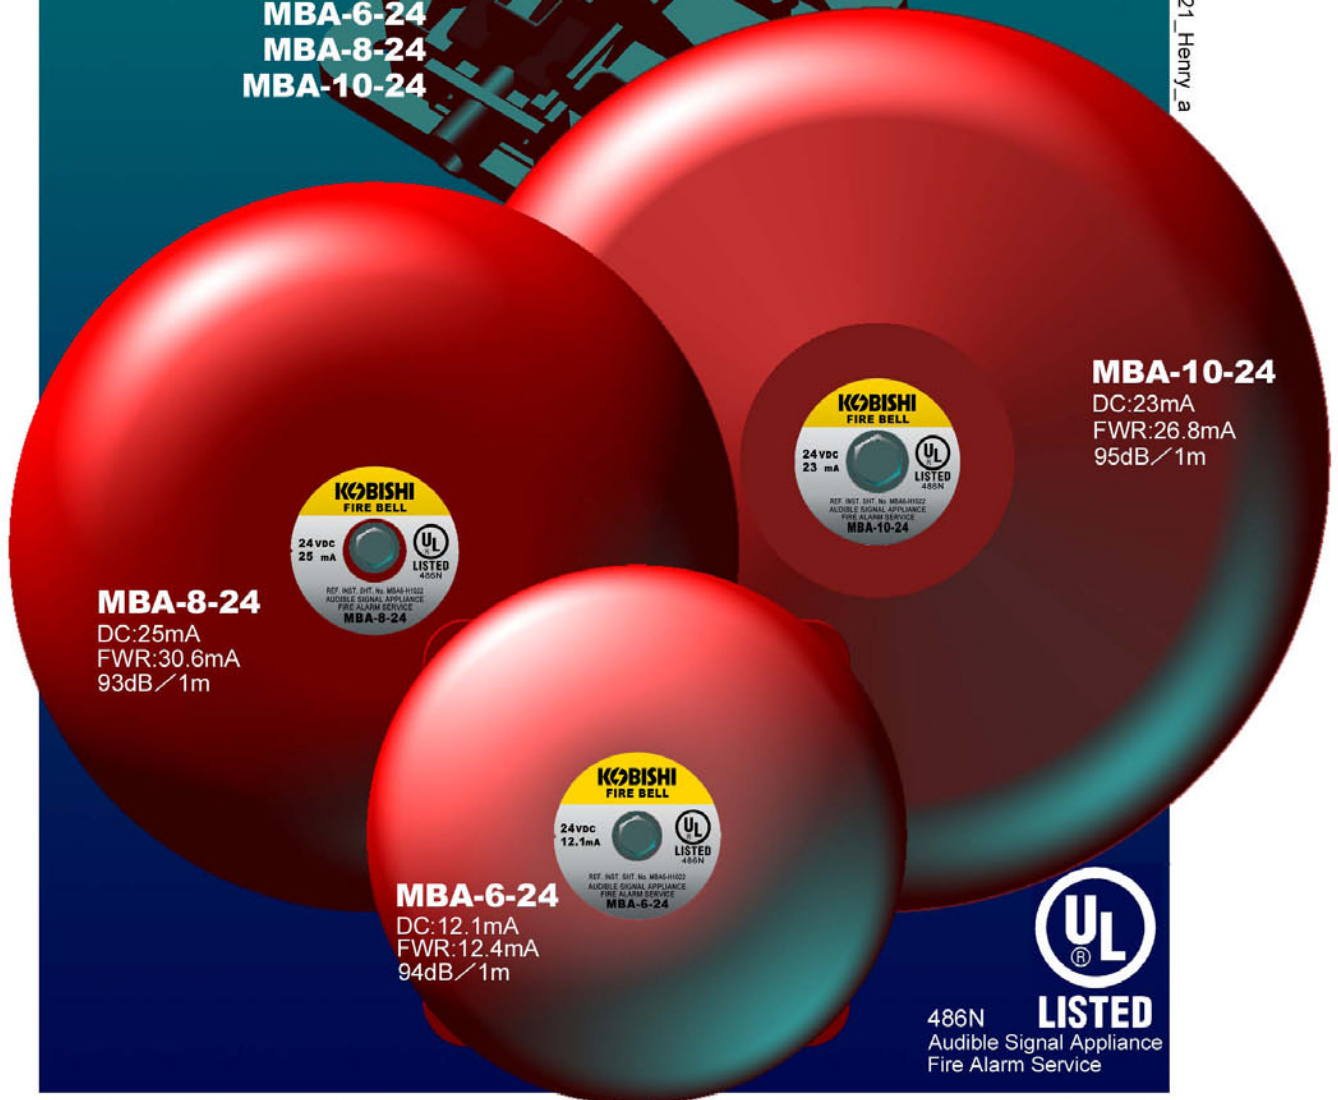

MBA-8-24
DC:25mA
FWR:30.6mA
93dB/1m

MBA-6-24
DC:12.1mA
FWR:12.4mA
94dB/1m

MBA-10-24
DC:23mA
FWR:26.8mA
95dB/1m



486N
LISTED
Audible Signal Appliance
Fire Alarm Service

DESIGN AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE

- ▲CAN BE USED AT OUTDOOR
- ▲VERY LOW CURRENT CONSUMPTION ONLY 12.1mA at 24VDC
(Model MBA-6-24)

Installation

